




LEUCOS®

INSTALLATION INSTRUCTIONS for LEUCOS USA

GLO' Recessed

A1 Enclosed  Opening Ø 95 mm  Two installers  Save instructions Revised 17 February 2004

WARNING: BEFORE BEGINNING THE INSTALLATION OF THE FIXTURE MAKE SURE TO TURN THE POWER OFF. - PLEASE HANDLE THE GLASS DIFFUSER CAREFULLY IN ORDER TO AVOID SCRATCHING IT.

Please note: Do not cover this fixture with insulating material .

- Fig.1** Insert bracket "A", of collar "B", inside the opening, as shown, then take care to put bracket "A" on a flat-full contact with the inside surface of the false ceiling. **Fig.2.**
- Fig.1-2** Tighten screws "C" in order to obtain a complete and safe locking of the two parts "A" and "B" on the ceiling thick.
- Fig.3-4** Sleeve wires with the red thermal tubes provided. Connect supply wires to the terminal block "D". Be carefull to ceck the correct polarity.
Please note: the length of the wire cannot be altered. - Insert bulb
- Fig.3** Guide the glass top tube inside the structure "F", as shown, then lock it inside the collar ring by passing the metal rod "E" through the corresponding holes and finally secure it by tightening the threaded head "H".
- Fig. 4-5** Guide now the fixture-glass inside the fixture "B" on the ceiling then secure it by tightening the three screws "G" on the corresponding pins "I". - Restore power.

LOW VOLTAGE SUPPLY VERSION::

- This fixture complies with CEI 34-21 only if installed with a transformer according to standards.
- The electrical supply wires must be rated at least 150°C

Minimum distance between lamp and objects $\geq 0,5m$

LOW VOLTAGE SUPPLY VERSION:


- This fixture complies with CEI 34-21 only if installed with a transformer according to standards.
- The electrical supply wires must be rated at least 150°C.



SUPPLY LIME VERSION :



CIRCUIT DIAGRAM:

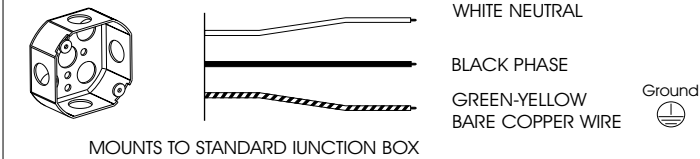

For additional information please contact your local dealer or LEUCOS USA at: tel. (732) 225-0010 fax (732) 225-0250

